


1000 Gallon Septic Tank

Weight: 9000 lbs.
 Item # 2039 Standard
 Item # 2133 Heavy Duty

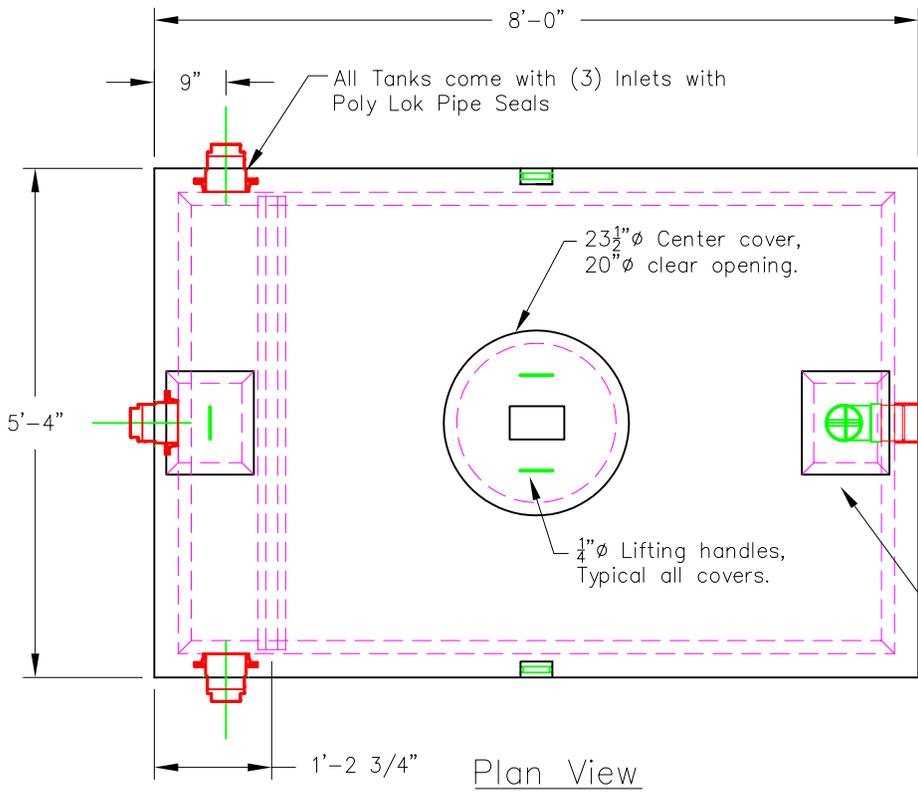

General Notes:


Concrete Specifications:

- 1) 4000 psi @ 28 Days
- 2) 4%-6% Entrained Air
- 3) Tank Penetrations are integrally cast
- 4) All joints sealed with butyl rubber joint sealant

Septic Tank Information:

- 1) Tanks Should be pumped every 3-5 years
- 2) Center access covers should have risers to bring cover access to grade.
- 3) Tanks can be vacuum tested at an additional cost

11" X 13" Cleanout cover
 at each end of tank.
 8" X 10" clear opening.

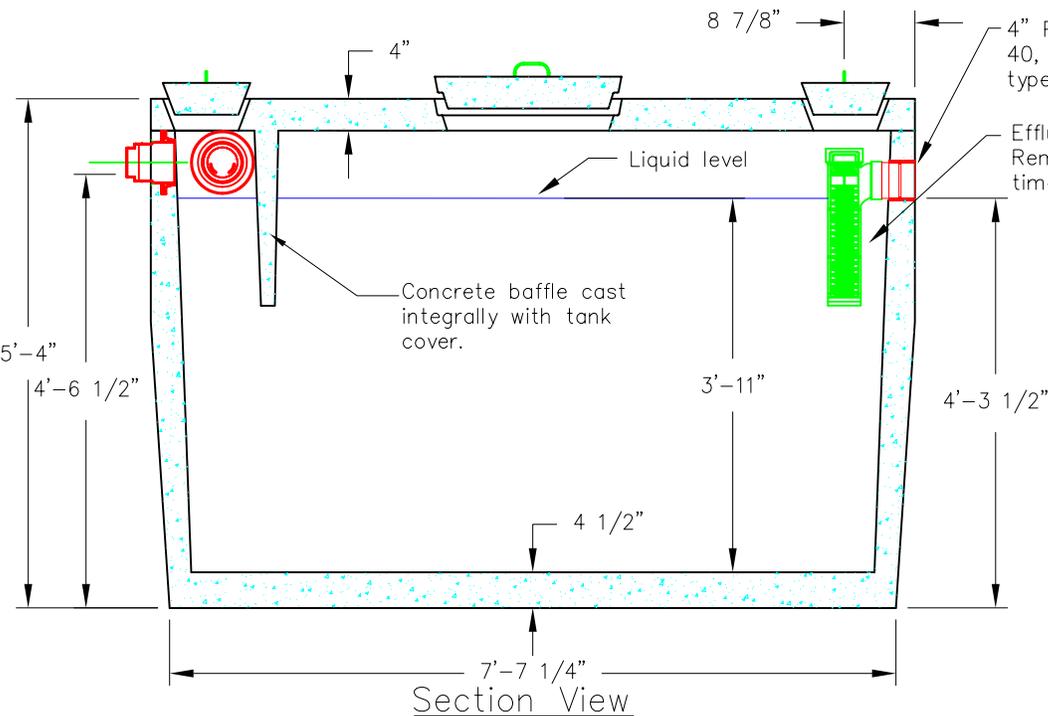

4" PVC coupling accepts SCH 40, SDR 35 or S&D. All pipe types should be glued.

Effluent filter installed on outlet. Remove, clean and reinstall every time tank is pumped.



American Concrete Industries

2022 Minot Ave. Auburn, ME / 1717 Stillwater Ave. Veazie, ME
 Tel: 207-784-1388 / Tel: 207-947-8334

Last Revised:
 01/06

PG. XXX